


# Hydrant Information Sheet

Hydrant Number	<input type="text" value="A14"/>
Hydrant Location	<input type="text" value="Skyline Mountain Resort 12135 East Fairview Drive Fairview, Utah 84629"/>
Nozzle Coefficient	<input type="text" value="0.90"/>
Nozzle I.D., inches	<input type="text" value="2.50"/>
Pitot Pressure	<input type="text" value="20"/>
Residual Pressure	<input type="text" value="20"/>
Static Pressure	<input type="text" value="60"/>
Flow, gpm =	<input type="text" value="755"/>
Flow, gpm at 20 psi=	<input type="text" value="755"/>

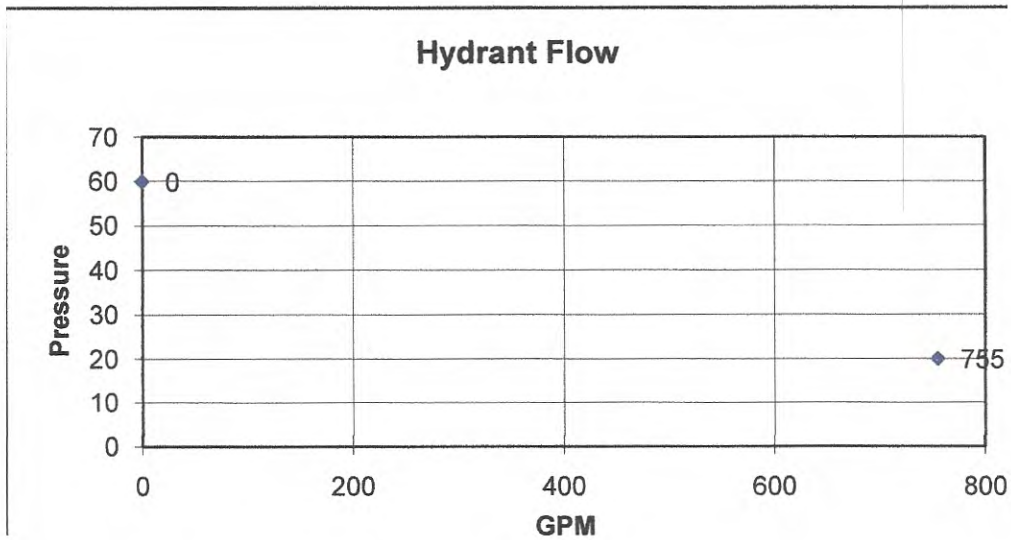

# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure


Flow, gpm =

Flow, gpm at 20 psi=

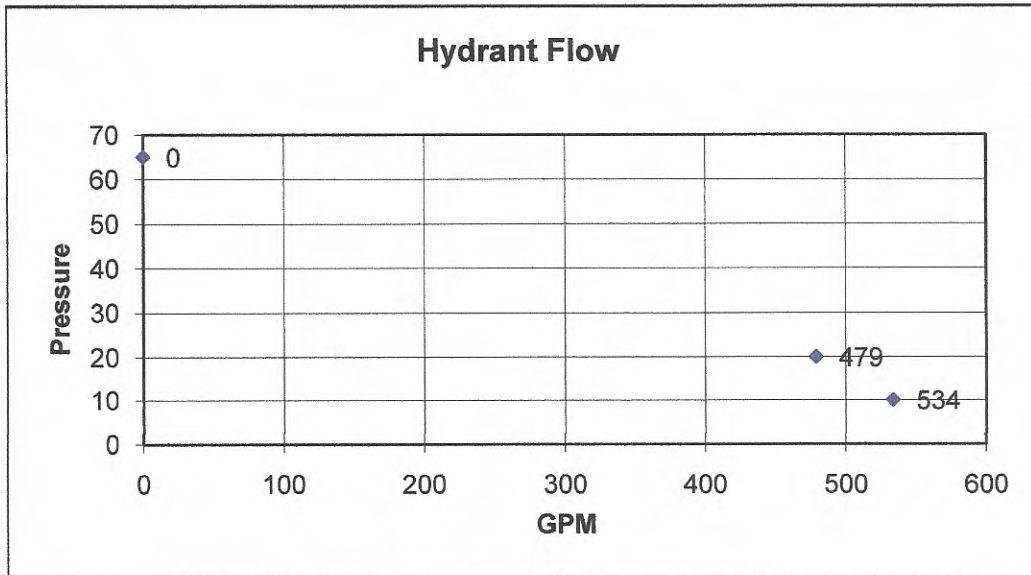

# Hydrant Information Sheet

Hydrant Number	B56
Hydrant Location	Skyline Mountain Resort 22440 North Spring Creek Drive Fairview, Utah 84629
Nozzle Coefficient	0.90
Nozzle I.D., inches	2.50
Pitot Pressure	40
Residual Pressure	50
Static Pressure	97
Flow, gpm =	1067
Flow, gpm at 20 psi=	1393

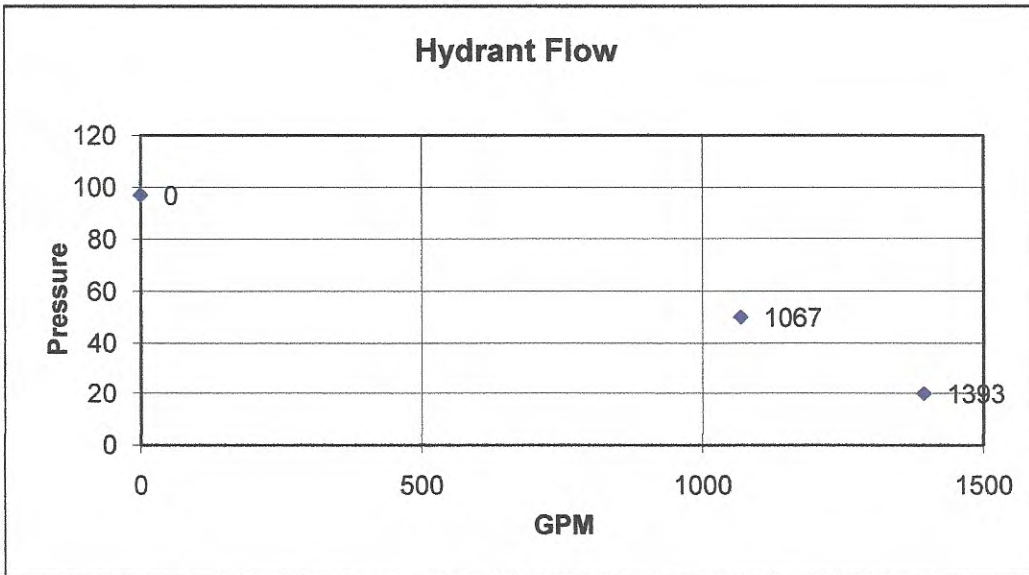

# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure

Flow, gpm =

Flow, gpm at 20 psi=

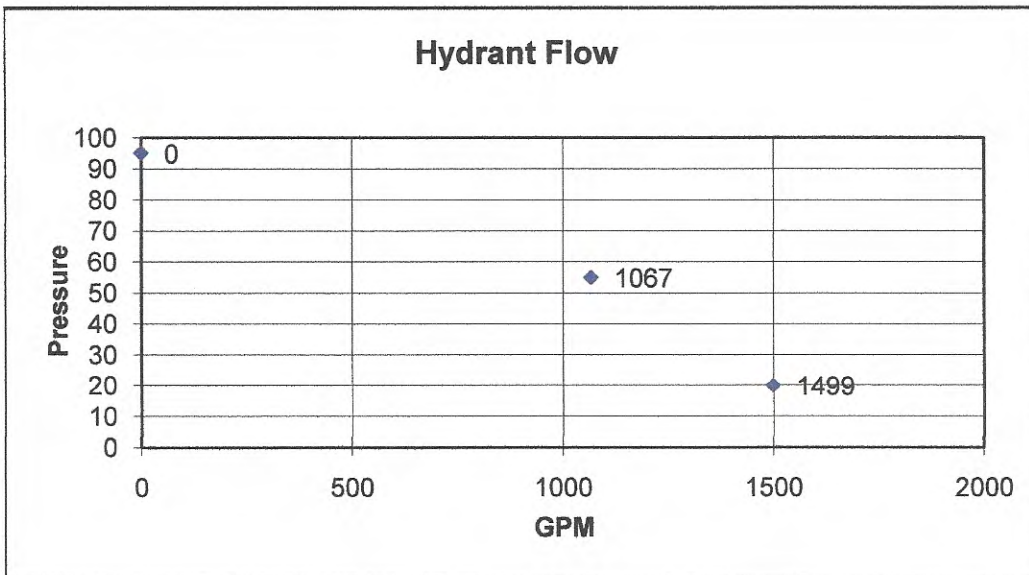

# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure


Flow, gpm =

Flow, gpm at 20 psi=

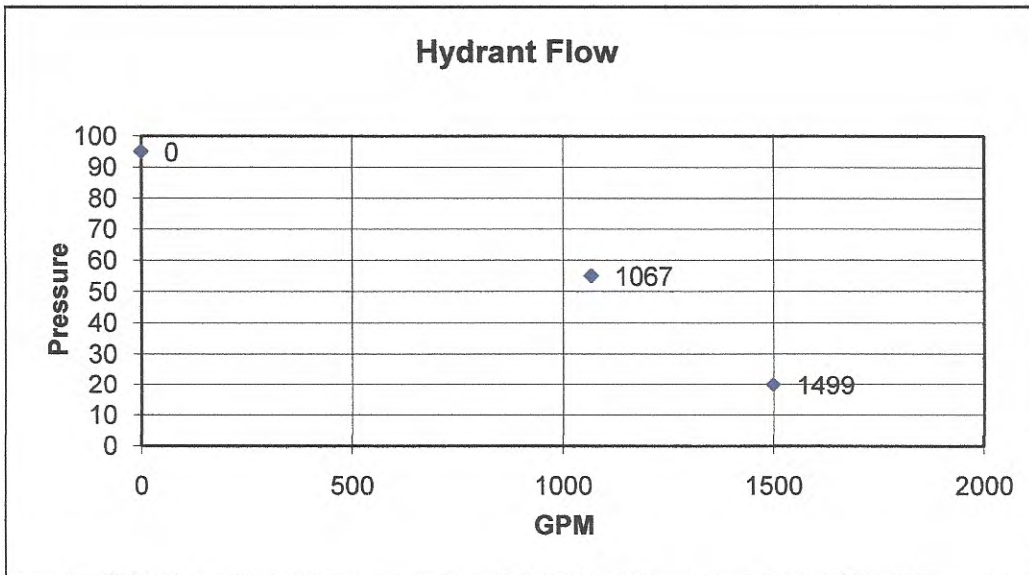


# Hydrant Information Sheet

Hydrant Number	<input type="text" value="B48"/>
Hydrant Location	<input type="text" value="Skyline Mountain Resort 12510 East Juniper Drive Fairview, Utah 84629"/>
Nozzle Coefficient	<input type="text" value="0.90"/>
Nozzle I.D., inches	<input type="text" value="2.50"/>
Pitot Pressure	<input type="text" value="25"/>
Residual Pressure	<input type="text" value="25"/>
Static Pressure	<input type="text" value="65"/>
Flow, gpm =	<input type="text" value="844"/>
Flow, gpm at 20 psi=	<input type="text" value="899"/>

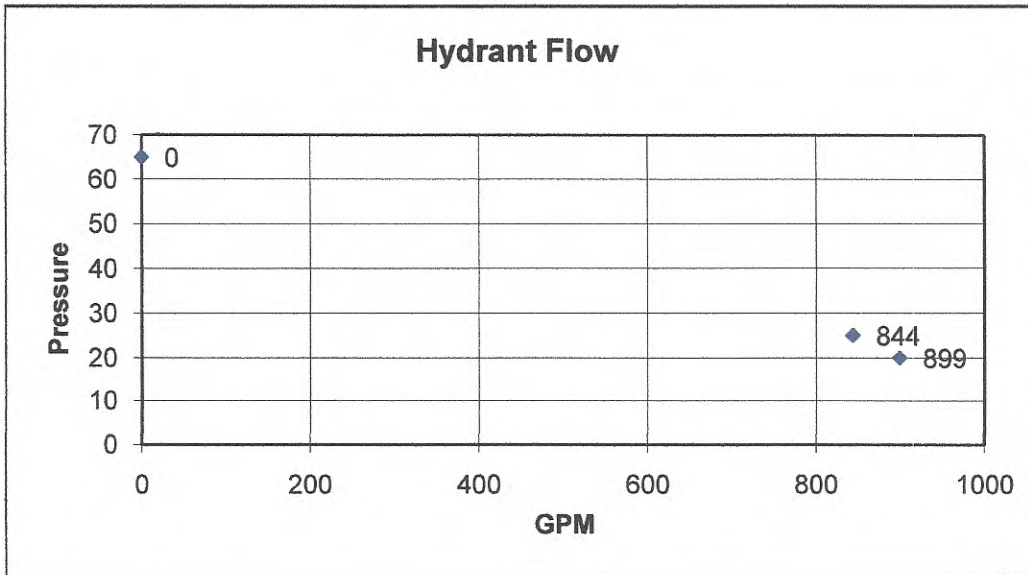


# Hydrant Information Sheet

Hydrant Number	B102
Hydrant Location	Skyline Mountain Resort 22565 North Juniper View Drive Fairview, Utah 84629
Nozzle Coefficient	0.90
Nozzle I.D., inches	2.50
Pitot Pressure	18
Residual Pressure	18
Static Pressure	55
Flow, gpm =	716
Flow, gpm at 20 psi=	695

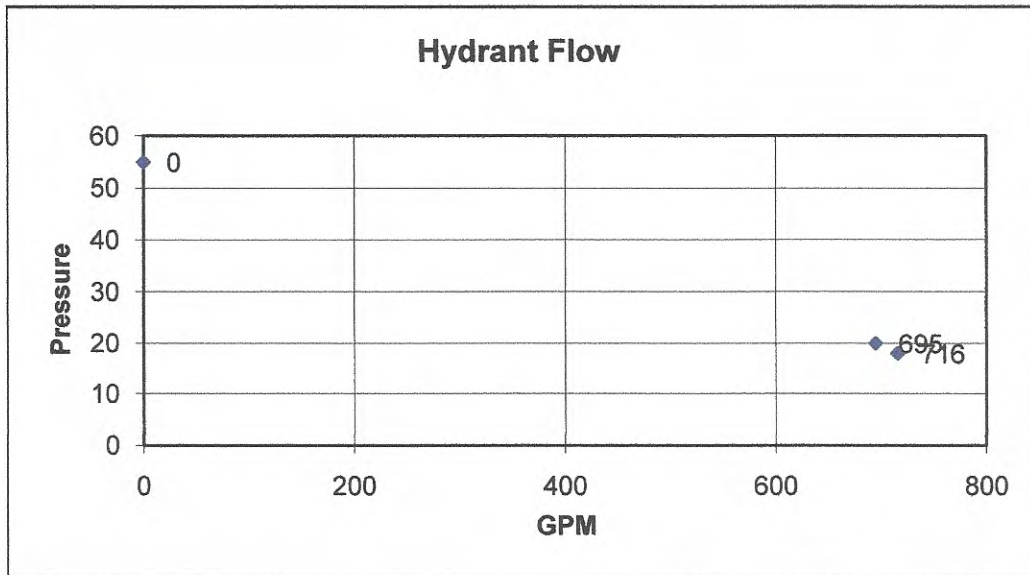

# Hydrant Information Sheet

Hydrant Number	B121
Hydrant Location	Skyline Mountain Resort 22760 North Juniper View Drive Fairview, Utah 84629
Nozzle Coefficient	0.90
Nozzle I.D., inches	2.50
Pitot Pressure	50
Residual Pressure	50
Static Pressure	100
Flow, gpm =	1193
Flow, gpm at 20 psi=	1538

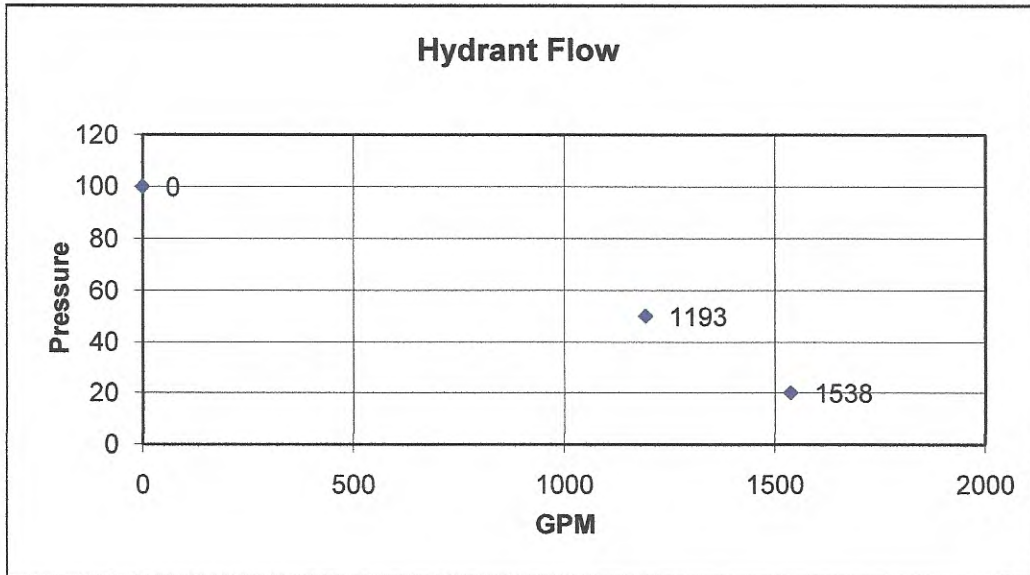



# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure

Flow, gpm =

Flow, gpm at 20 psi=

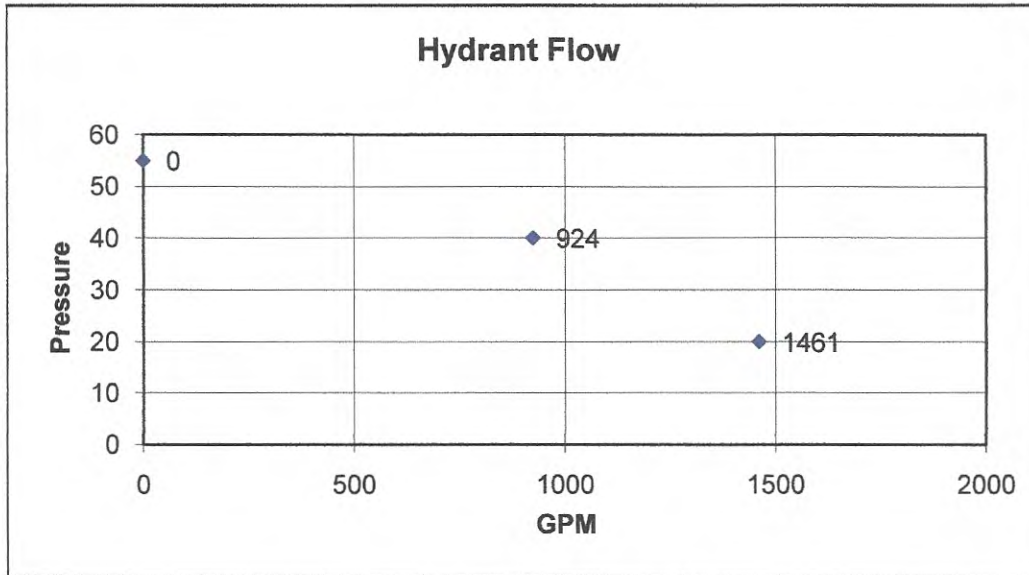

# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure

Flow, gpm =

Flow, gpm at 20 psi=

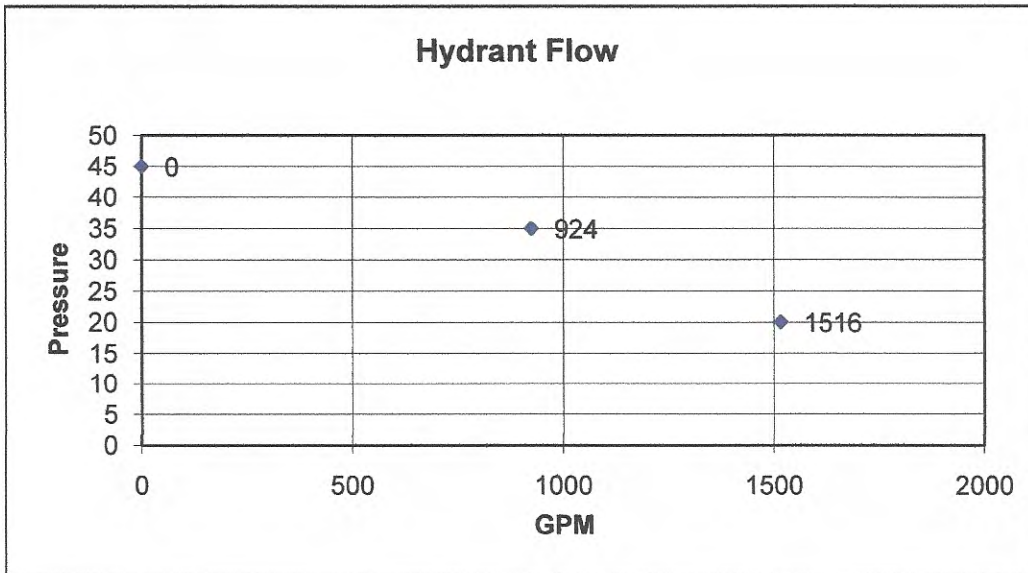

# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure

Flow, gpm =

Flow, gpm at 20 psi=

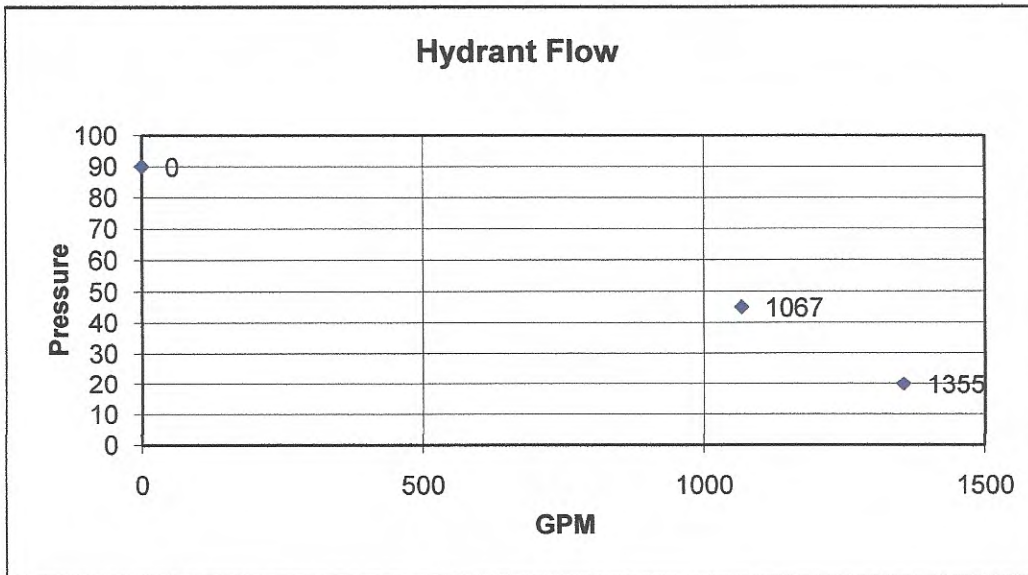

# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure

Flow, gpm =

Flow, gpm at 20 psi=

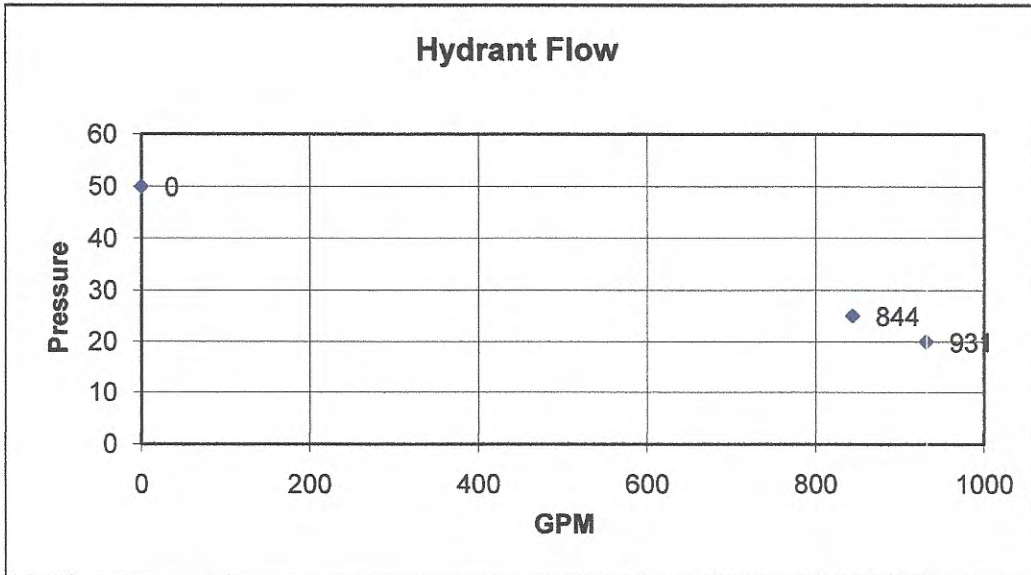

# Hydrant Information Sheet

Hydrant Number

Hydrant Location

Nozzle Coefficient

Nozzle I.D., inches


Pitot Pressure

Residual Pressure

Static Pressure


Flow, gpm =

Flow, gpm at 20 psi=

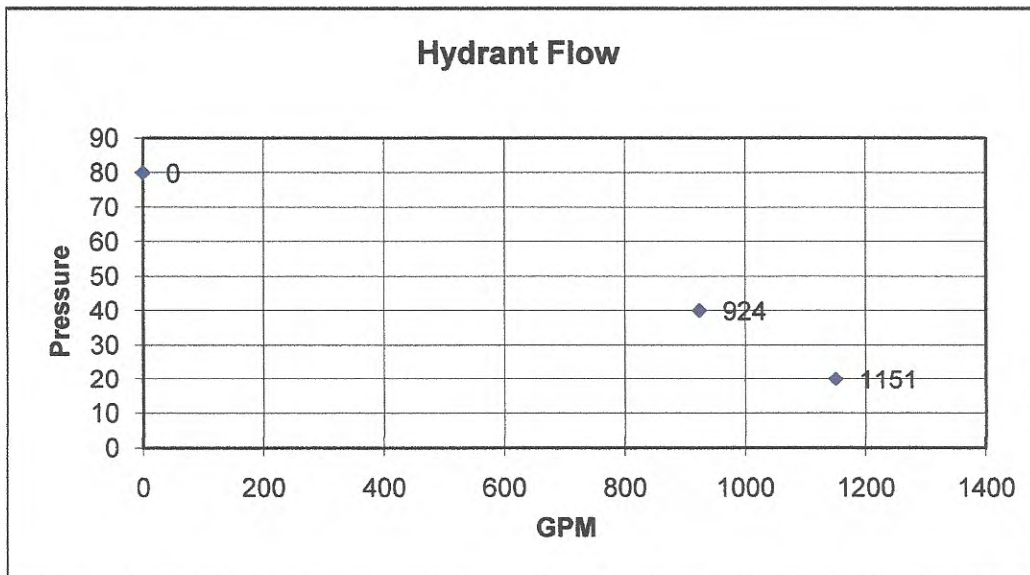

# Hydrant Information Sheet

Hydrant Number	E21
Hydrant Location	Skyline Mountain Resort 2213 North Owen Thomas Drive by Old Managers House Fairview, Utah 84629
Nozzle Coefficient	0.90
Nozzle I.D., inches	2.50
Pitot Pressure	3
Residual Pressure	3
Static Pressure	100
Flow, gpm =	292
Flow, gpm at 20 psi=	263

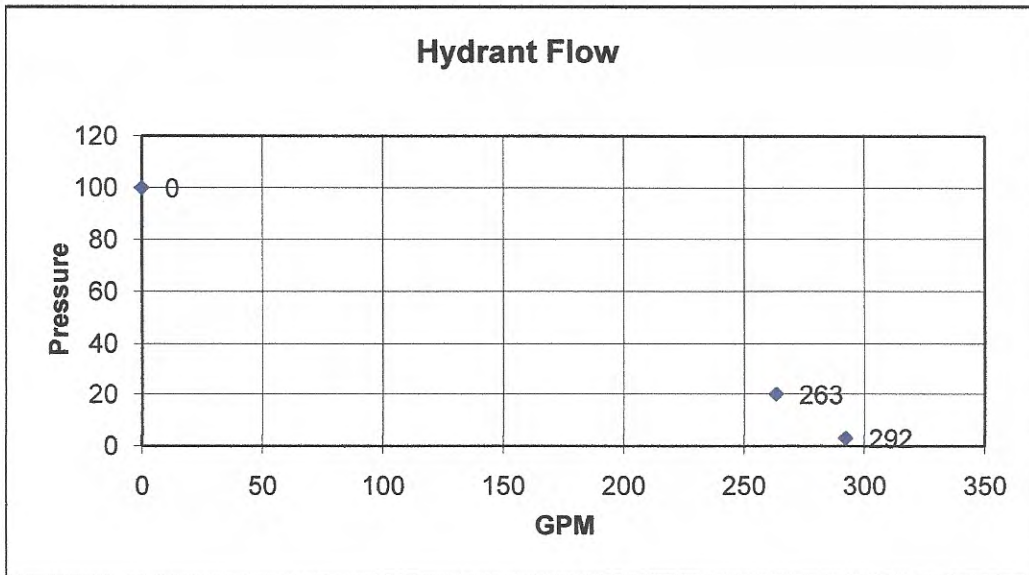

# Hydrant Information Sheet

Hydrant Number	Pavilion
Hydrant Location	Skyline Mountain Resort 22130 North 11750 East by New Club House Fairview, Utah 84629
Nozzle Coefficient	0.90
Nozzle I.D., inches	2.50
Pitot Pressure	40
Residual Pressure	50
Static Pressure	90
Flow, gpm =	1067
Flow, gpm at 20 psi=	1444

